



SEE DWG. T-050 FOR STANDARD STREET WIDTHS AND SECTIONS

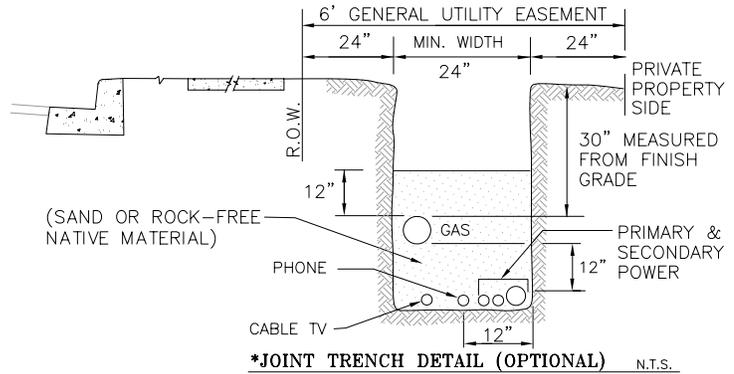

NOTES:

1. WATER LOCATED 3'-6" INSIDE FROM FACE OF CURB OR AS OTHERWISE DIRECTED.
2. 10' HORIZONTAL SEPARATION BETWEEN WATER AND SEWER WHERE POSSIBLE. COMPLY WITH SEPARATION REQUIREMENTS OF OAR 333-061-050.
3. WATER DISTRIBUTION MAINS SHALL HAVE 36" MINIMUM COVER OR AS OTHERWISE DIRECTED.
4. SEWER MAINS SHALL HAVE 5.25' (63") MINIMUM COVER UNLESS OTHERWISE APPROVED TO AVOID CONFLICTS WITH WATER AND OTHER UTILITIES.
5. WATER LOCATED ON NORTH OR EAST SIDE OF STREET WHEN PRACTICAL.
6. WATER, SEWER, STREETS AND DRAINAGE SUBJECT TO CITY STANDARDS.
7. MANHOLE LIDS SHALL NOT BE LOCATED DIRECTLY IN NORMAL WHEEL PATH.
8. ALL LAYOUTS AND LOCATIONS ARE SUBJECT TO CITY APPROVAL.

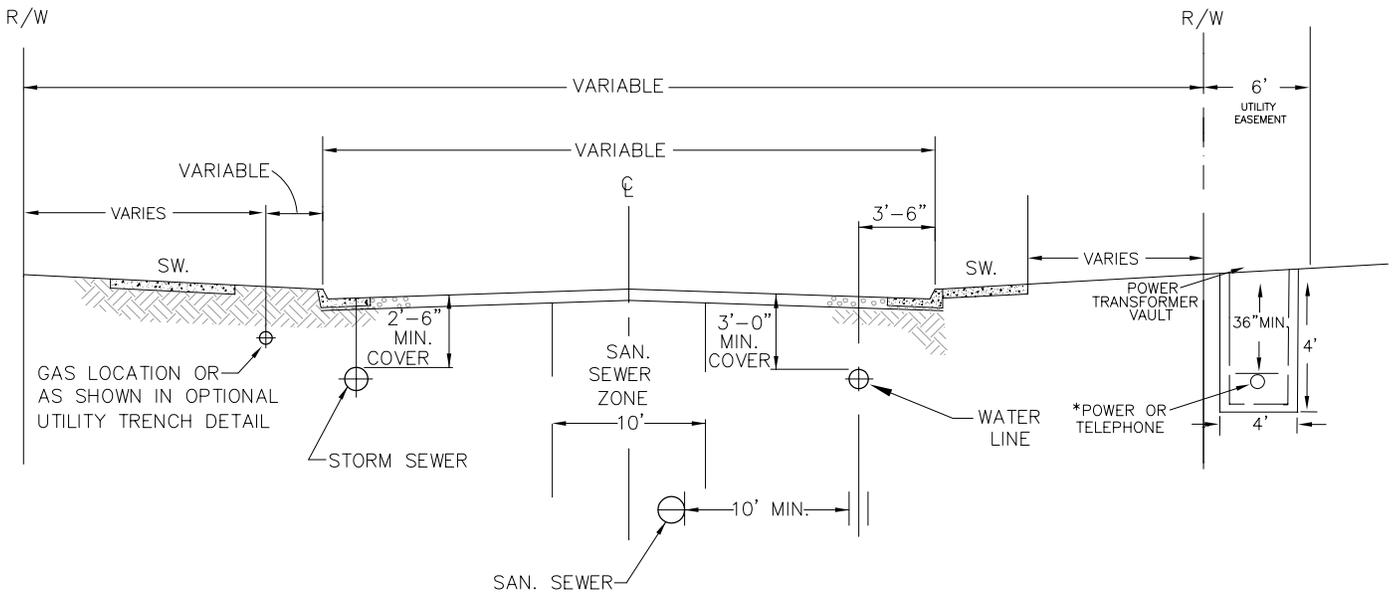

City of Amity
 109 Maddox Street
 Amity, Oregon 97101
 503.835.3711

STANDARD UTILITY LOCATIONS

DETAIL NO.

S-050

3/22/04