


TYPICAL CURB & GUTTER

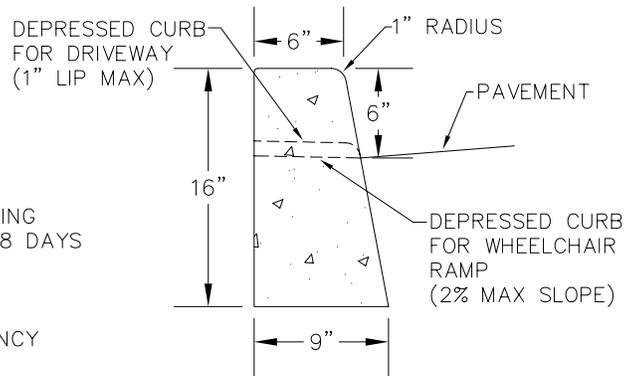

TYPICAL STRAIGHT CURB (TYPE C)

NOTES:

1. CONCRETE SHALL HAVE A BREAKING STRENGTH OF 3300 PSI AFTER 28 DAYS
2. CONTRACTION JOINTS
  - A) TO BE PROVIDED
    - AT EACH POINT OF TANGENCY
    - AT EACH COLD JOINT
    - AT EACH SIDE OF INLET STRUCTURES
    - AT BOTH SIDES OF AN APPROACH
  - B) SPACING TO BE NOT MORE THAN 15 FEET
  - C) THE DEPTH OF THE JOINT SHALL BE AT LEAST 1/3 OF THE THICKNESS OF CONCRETE
  - D) EXPANSION JOINTS SHALL NOT BE USED
3. BASE ROCK - 1-1/2"-0", 95% COMPACTION  
ROCK SHALL BE TO SUBGRADE OF THE STREET SECTION OR 4" IN DEPTH, WHICHEVER IS GREATER
4. DRAINAGE BLOCK - 3" DIA. PLASTIC PIPE
  - A) DRAINAGE ACCESS THROUGH EXISTING CURBS SHALL BE DONE BY:
    - CORE DRILLING, OR
    - VERTICAL SAWCUT OF CURB 18" EACH SIDE OF DRAIN AND RE-POURED TO FULL DEPTH OF CURB
5. STAMP TOP OF CURB WITH "W" AT WATER SERVICE CROSSING AND "S" AT SANITARY LATERAL CROSSING AS SPECIFIED



City of Amity  
109 Maddox Street  
Amity, Oregon 97101  
503.835.3711

CURB AND GUTTER DETAILS

DETAIL NO.

T-301

3/31/04