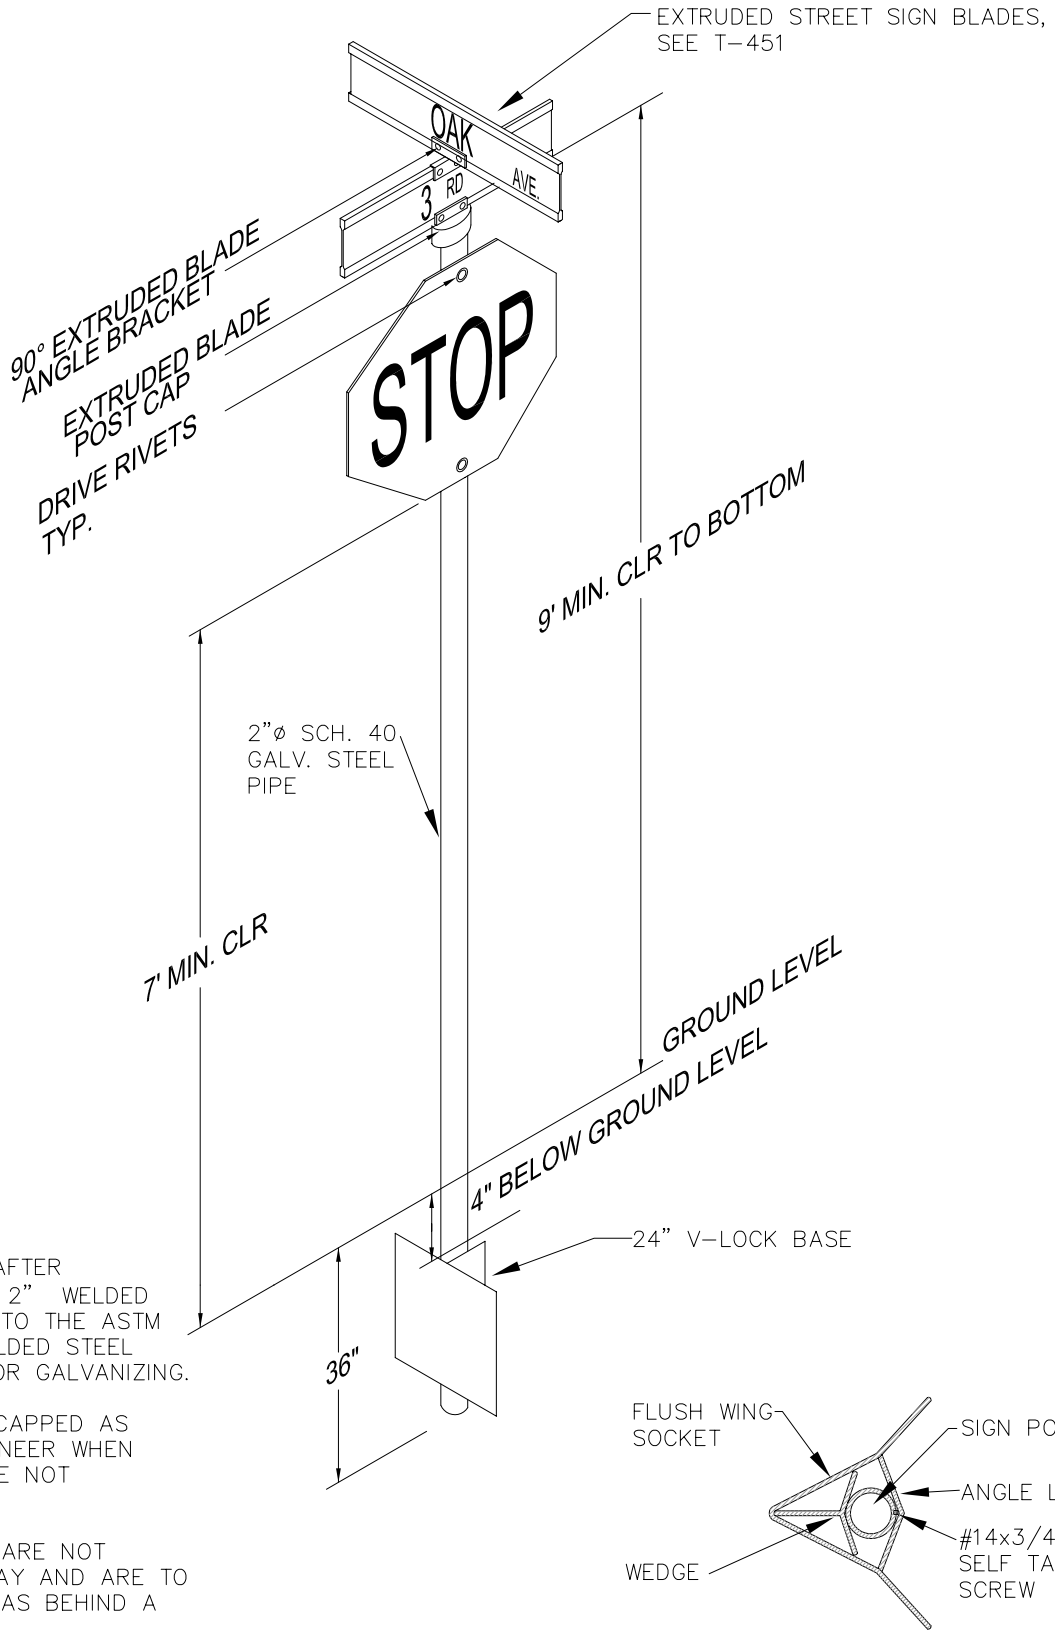

NOTES:

1. HOT DIP GALVANIZE AFTER FABRICATION STANDARD 2" WELDED STEEL PIPE. CONFORM TO THE ASTM SPECIFICATIONS FOR WELDED STEEL PIPE A120 AND A123 FOR GALVANIZING.

2. ALL PIPE SHALL BE CAPPED AS APPROVED BY THE ENGINEER WHEN STREET NAME SIGNS ARE NOT REQUIRED.

3. THE PIPE SUPPORTS ARE NOT CONSIDERED BREAK-AWAY AND ARE TO BE USED IN URBAN AREAS BEHIND A VERTICAL CURB.

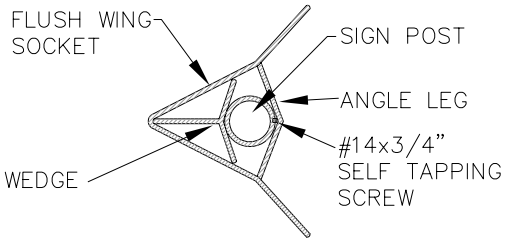

V-LOCK MOUNTING BRACKET

City of Amity
109 Maddox Street
Amity, Oregon 97101
503.835.3711

STANDARD SIGN DETAIL

DETAIL NO.

T-450

3/31/04